



CODE 382 - FENCE
ELECTRIC FENCE GATE OPTIONS

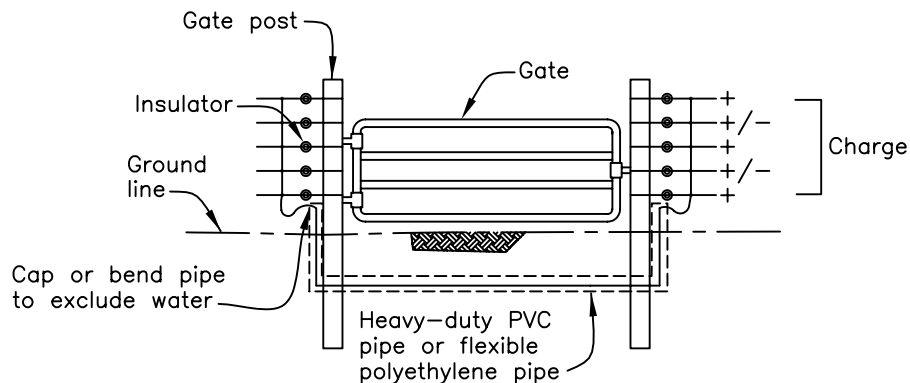

ROAD CROSSING DETAIL

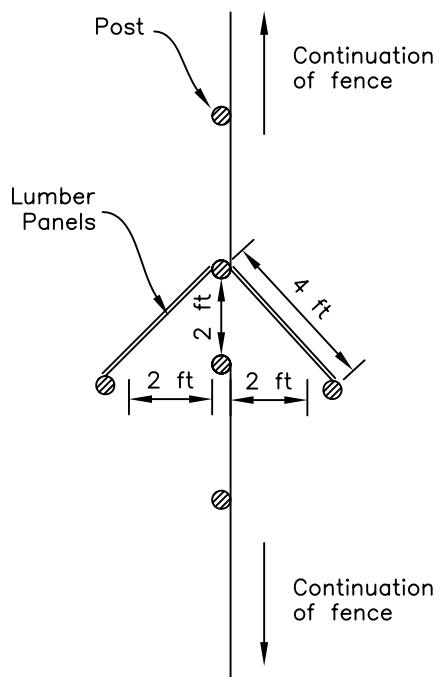

Walk Through Gate Notes

1. Options:
 - a) Use 1-2 strands of 12.5 gauge high tensile coiled or expandable wire or cables attached to an insulated handle, or
 - b) 12 gauge direct burial, or
 - c) THHN wire or equivalent in underground pipe or
 - d) Non-electric fence
2. Install safety sign identifying "hot" wires and gate.
3. Preference should be given to underground burial of electric wires.

WALK-THROUGH GATE DETAIL